
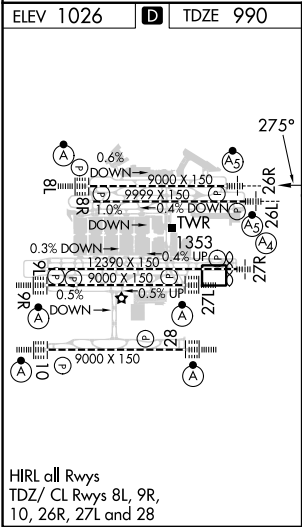


APP CRS	Rwy Idg	8500
275°	TDZE	990
	Apt Elev	1026

RNAV (RNP) Z RWY 26R
HARTSFIELD-JACKSON ATLANTA INTL (ATL)

▼ For uncompensated Baro-VNAV systems, procedure NA below -8°C (18°F) or above 54°C (130°F). GPS required. Simultaneous approach authorized. Arrival from BROOX NA during simultaneous triple approaches.						MALSR AS	MISSED APPROACH: Climb to 1500 then climbing right turn to 3500 direct TROYS and hold.		
D-ATIS	ATLANTA	ATLANTA TOWER				ALL	GND CON		
ARR 119.65	APP CON	8L-26R	8R-26L	9L-27R	9R-27L	10-28	RWYS	(8L-26R,8R-26L)	(9L-27R,9R-27L)
DEP 125.55	127.9	379.9	119.1	125.325	123.85	119.3	119.5	254.4	121.9
									121.75
									121.65
									254.4

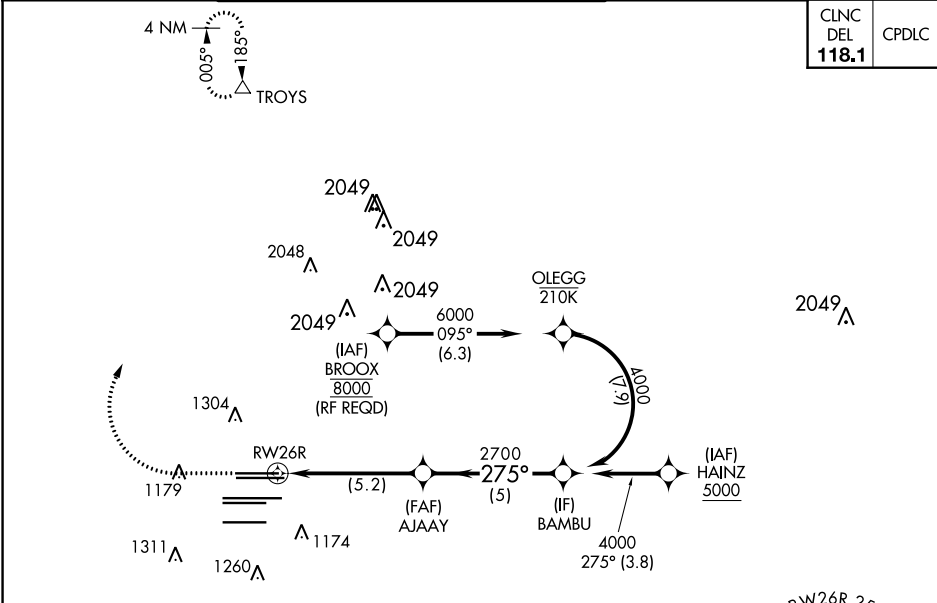

1500	3500	TROYS	VGSi and RNAV glidepath not coincident (VGSi Angle 3.00°/TCH 69°).		BAMBU
			AJAAY	2700	4000
			RW26R	2700	275°
				2700	
				5.2 NM	5 NM
CATEGORY	A	B	C	D	
RNP 0.30 DA		1402/45	412 (400-1)		
AUTHORIZATION REQUIRED					
GP 3.00° TCH 55					