RNAV (RNP) Z RWY 26L

MIAMI INTL (MIA)

APP CRS	Rwy Idg	10220
272°	TDZE	9
	Apt Elev	9

RNP AR APCH-GPS.

Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below 8°C or above 54°C. For inop ALS, increase RNP 0.20 visibility to RVR 5500 for all Cats and increase RNP 0.30 visibility to RVR 6000 for all Cats.

MALSF

MISSED APPROACH: Climb to 800 then climbing right turn to 4000 direct BRBRA and hold, continue climb-in-hold to 4000.

D-ATIS	MIAMI APP CON	MIAMI TOWER	GND CON	CLNC DEL	CPDLC
ARR 119.15 DEP 133.675	124.85 322.3	118.3 256.9	121.8 (8L/8R/12/26L/26R) 348.6 127.5 (9/27/30)	135.35	

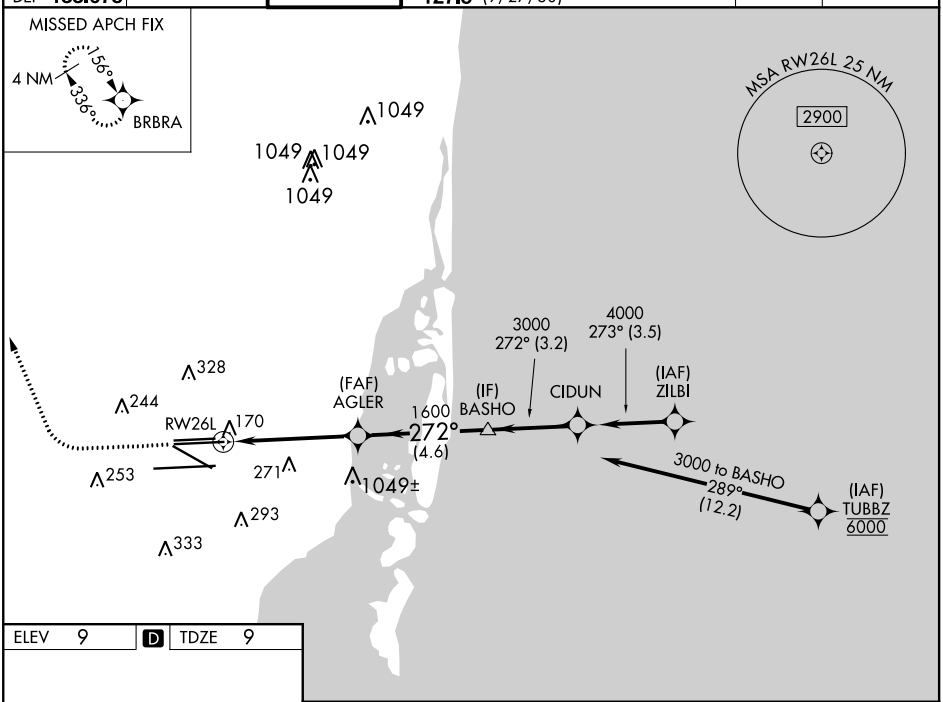

ELEV 9	D	TDZE 9

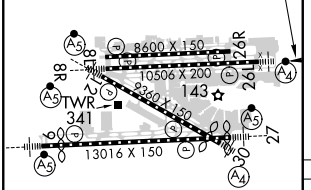

TDZ/CL Rwy 8R
REIL Rwys 8L and 26R
HIRL all Rwys

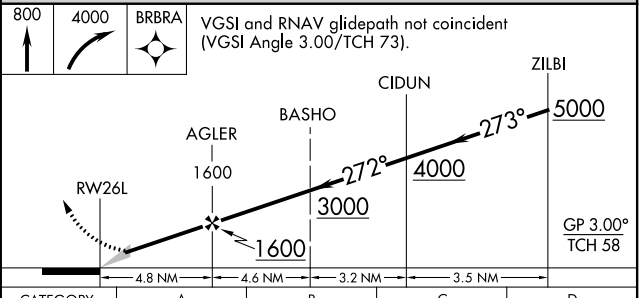

CATEGORY	A	B	C	D
RNP 0.20 DA	368/40	359 (400-¾)		
RNP 0.30 DA	418/50	409 (500-1)		

AUTHORIZATION REQUIRED

SE-3, 04 NOV 2021 to 02 DEC 2021
SE-3, 04 NOV 2021 to 02 DEC 2021