

RNAV (RNP) Z RWY 31

CORPUS CHRISTI INTL (CRP)


APP CRS 312°	Rwy ldg 7510
	TDZE 43
	Apt Elev 46

▼ For uncompensated Baro-VNAV systems, procedure NA below -1°C (31°F) or above 54°C (130°F). GPS and RF required. For inop MALSR, increase RNP 0.14 all Cats visibility to 7/8 mile.
* Missed approach requires minimum climb of 335 feet per NM to 500.




MISSED APPROACH: Climb to 2000 on track 312° to ATHIS and hold.

ATIS 126.8	CORPUS APP CON 120.9 348.725	CORPUS TOWER 119.4 257.8	GND CON 121.9 269.15	CLNC DEL 118.55
----------------------	--	------------------------------------	--------------------------------	---------------------------

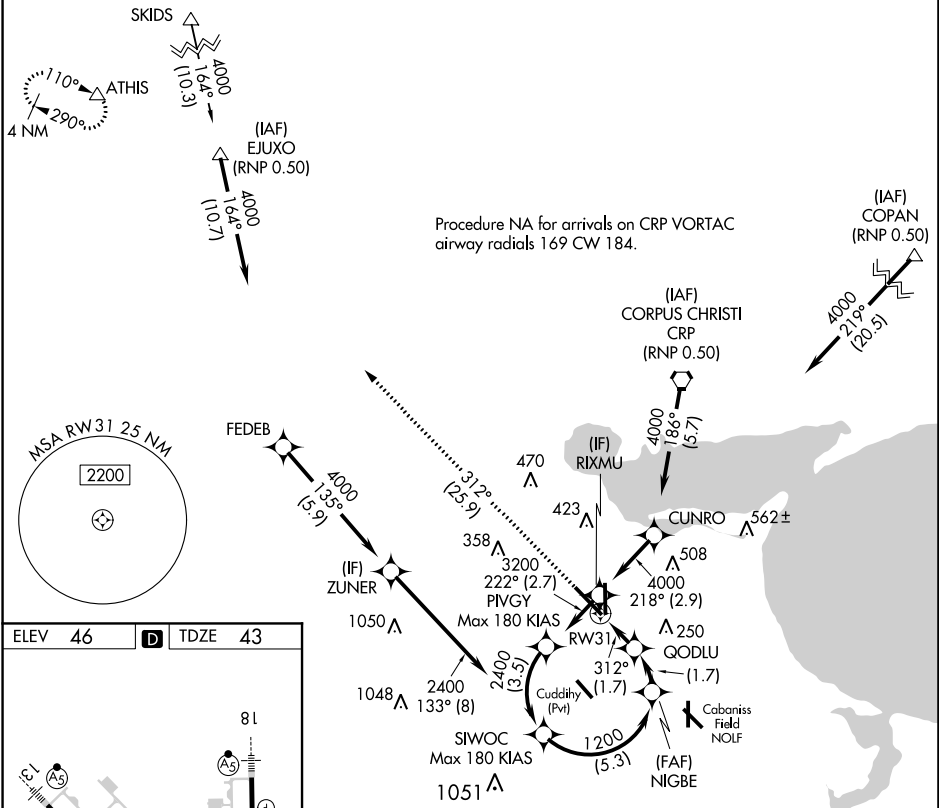

ELEV 46	D	TDZE 43
---------	----------	---------

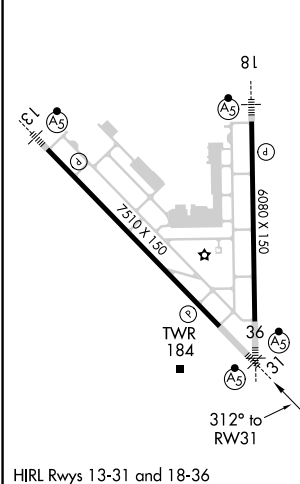

2000	ATHIS	See planview for multiple IF locations.	SIWOC
↑	fr 312°		
RW31	GODLU	NIGBE	2400
	646	1200	
	1.7 NM	1.7 NM	5.3 NM
CATEGORY	A	B	C
RNP 0.14 DA*		303-1/2	260 (300-1/2)
RNP 0.30 DA		384-5/8	341 (400-5/8)

AUTHORIZATION REQUIRED

SC-3, 02 DEC 2021 to 30 DEC 2021

SC-3, 02 DEC 2021 to 30 DEC 2021