


RNAV (GPS) Z RWY 3R
DETROIT METRO WAYNE COUNTY (DTW)

T For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized. LNAV procedure NA during simultaneous operations. Use of FD or AP required during simultaneous operations.

MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAAGE and hold, continue climb-in-hold to 4000.

D-ATIS 133.675	DETROIT APP CON 125.15 284.0	METRO TOWER 118.4 317.725	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)	CLNC DEL 120.65	CPDLC
-------------------	---------------------------------	------------------------------	---	--------------------	-------

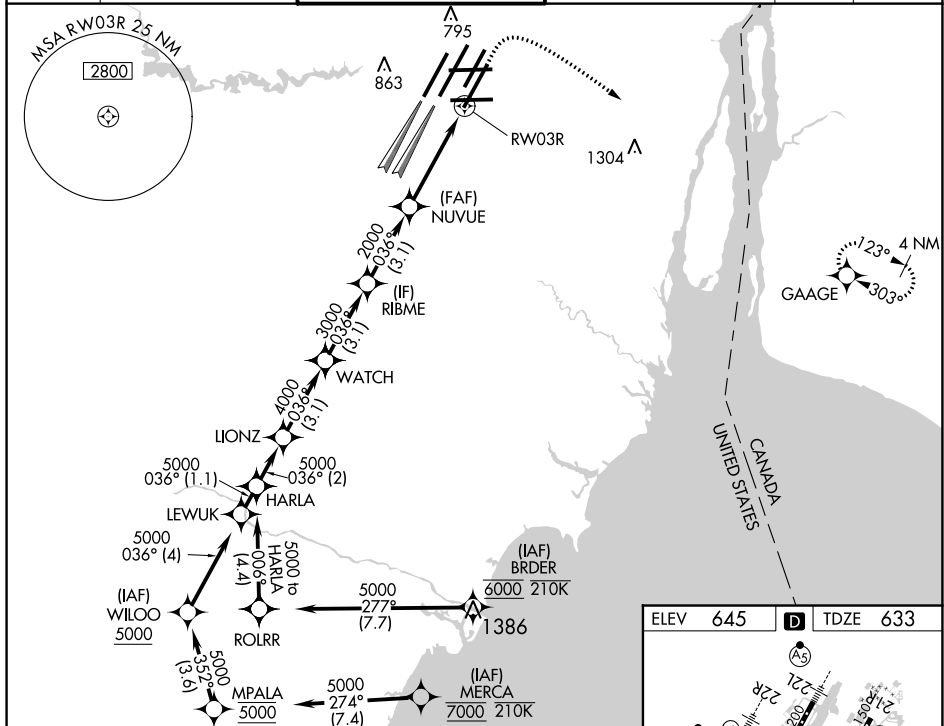

VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 70).

HARLA LIONZ WATCH RIBME NUVUE

5000 036° 5000 4000 3000 2000

GP 3.00° TCH 54

2 NM 3.1 NM 3.1 NM 3.1 NM 2.9 NM 1.2

* 1.2 NM to RW03R

RW03R

* LNAV only.

CATEGORY	A	B	C	D
LPV DA	833/18		200 (200-½)	
LNAV/VNAV DA	1013/35		380 (400-¾)	
LNAV MDA	1080/24	447 (500-½)	1080/45	447 (500-¾)
C CIRCLING	1180-1	535 (600-1)	1180-1½ 535 (600-1½)	1240-2 595 (600-2)

