

LOC/DME I-PUK 111.15 Chan 48 (Y)	APP CRS 162°	Rwy Idg TDZE 69 Apt Elev 69
--	------------------------	---

ILS RWY 16 (SA CAT I & II)
NORTHWEST FLORIDA BEACHES INTL (ECP)

DME required for procedure entry. DME required.


- SA CAT I: Requires specific OPSPEC, MSPEC, or LOA approval and use of HUD to DH.
SA CAT II: Reduced lighting: requires specific OPSPEC, MSPEC, or LOA approval and use of autoland or HUD to touchdown.

MALSR




MISSED APPROACH: Climb to 600 then climbing left turn to 4000 on heading 025° and on MAI VORTAC R-237 to OLISS INT/MAI 33 DME and hold, continue climb-in-hold to 4000.


ATIS 119.975	TYNDALL APP CON★ 125.2 (N above 5000')	PANAMA CITY TOWER★ 118.95 (CTAF) 0	GND CON 121.65
------------------------	--	---	--------------------------

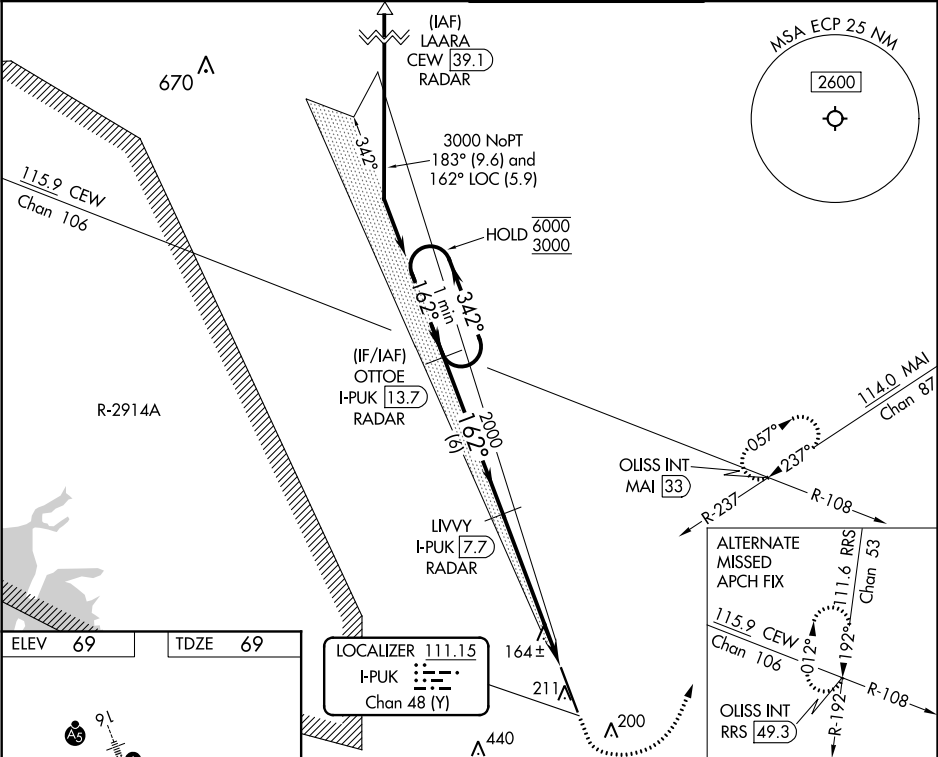

ELEV 69	TDZE 69
----------------	----------------

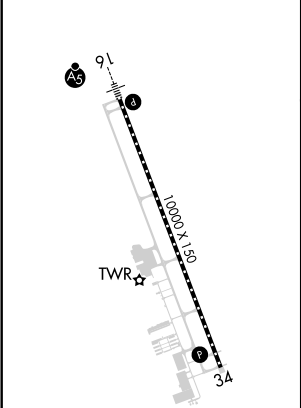

TDZ/CL Rwy 16 **0**
HIRL Rwy 16-34 **0**
REIL Rwy 34 **0**

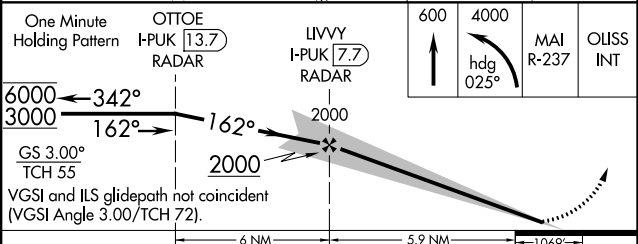

CATEGORY	A	B	C	D
S-ILS 16	SA CAT I	RA 151/14	150	DA 219
S-ILS 16	SA CAT II	RA 101/12	100	DA 169

SA CATEGORY I & II ILS - SPECIAL AIRCREW
& AIRCRAFT CERTIFICATION REQUIRED