

APP CRS

Rwy Idg

11494

TDZE

640

Apt Elev

645

036°

RNAV (RNP) X RWY 4R

DETROIT METRO WAYNE COUNTY (DTW)


RNP AR APCH.

ALSF-2

MISSED APPROACH: Climb to 4000 direct LUPAY and hold.

For uncompensated Baro-VNAV systems, procedure NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized.

D-ATIS	DETROIT APP CON	METRO TOWER	GND CON	CLNC DEL	CPDLC
133.675	124.05 284.0	128.125 317.725	121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)	120.65	

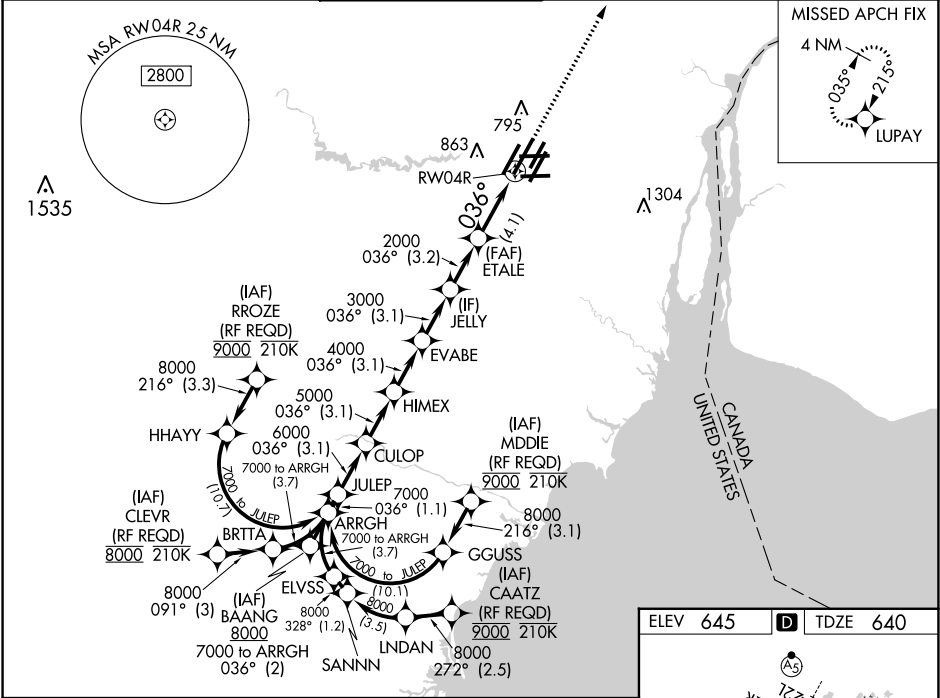

JULEP

7000

036°

CULOP

6000

HIMEX

5000

EVABE

4000

JELLY

3000

ETALE

2000

RW04R

GP 3.00°

TCH 52

4000

LUPAY

CATEGORY	A	B	C	D
RNP 0.30 DA	1031/35 391 (400-5%)			

AUTHORIZATION REQUIRED

ELEV 645

TDZE 640

TDZ/CL Rwy 3R, 4L, 4R and 22R
REIL Rwy 3L, 9L, 9R and 21R
HIRL all runways