

APP CRS
031°

Rwy Idg
TDZE
Apt Elev

7000
35
46

RNAV (RNP) Z RWY 3
CHARLESTON AFB/INTL (CHS)


RNP AR APCH.

▼

For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C.

MISSED APPROACH: Climb to 3000 direct BAMDE and hold, continue to climb-in-hold to 3000.

D-ATIS	CHARLESTON APP CON	CHARLESTON TOWER	GND CON	CLNC DEL	CPDLC
124.75	120.7 306.925	126.0 239.0	121.9 348.6	127.325 291.65	

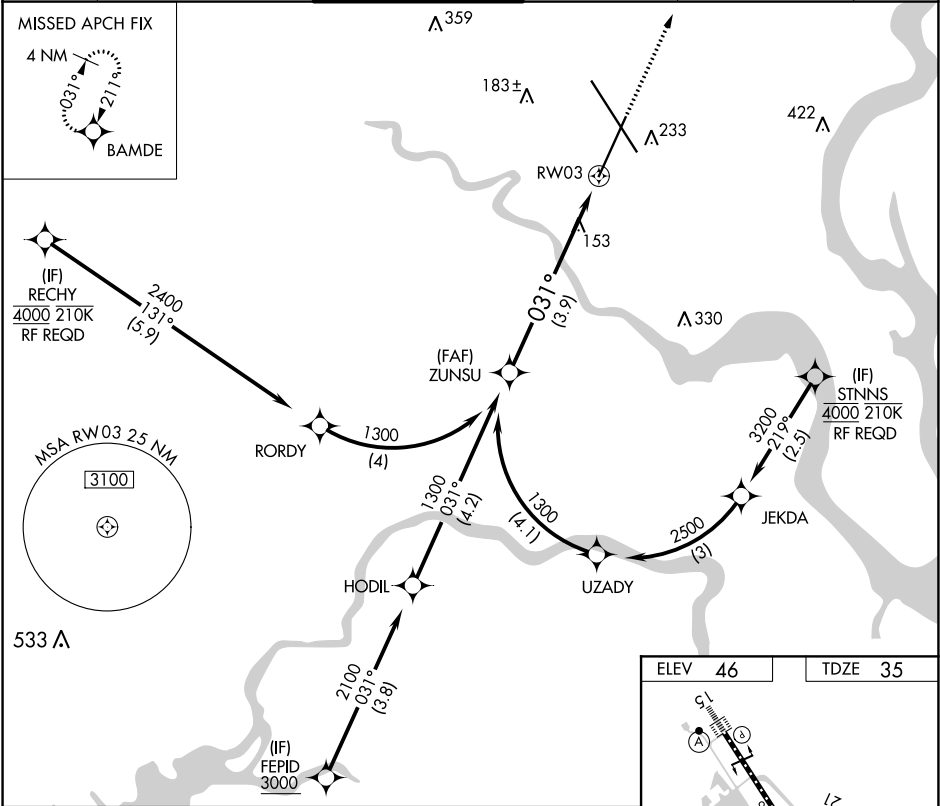

See planview for multiple IF locations.

3000

BAMDE

ZUNSU

1300

1300

031°

RW03

3.9 NM

GP 3.00°

TCH 50

CATEGORY	A	B	C	D
RNP 0.20 DA	285-3/4 250 (300-3/4)			
RNP 0.30 DA	429-11/8 394 (400-11/8)			

AUTHORIZATION REQUIRED

ELEV 46

TDZE 35

31

21

233

33

031°

0.38 Up

7000 X 150

3000 X 150

3

TDZ/CL Rwy 15
REIL Rwys 3 and 21
HIRL Rwys 3-21 and 15-33