


APP CRS	Rwy Idg	7701
137°	TDZE	27
	Apt Elev	29

RNAV (RNP) Y RWY 14
JACKSONVILLE INTL (JAX)

▼ For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required. For inoperative MALSR, increase RNP 0.30 all Cats	MALSR	MISSED APPROACH: Climb to 500 then climbing left turn to 2000 direct YEJWO and hold.
--	-------	--

D-ATIS	JACKSONVILLE APP CON	JACKSONVILLE TOWER	GND CON	CLNC DEL	CPDLC
125.85	119.0 269.9	118.3 317.7	121.9 348.6	119.5 290.275	

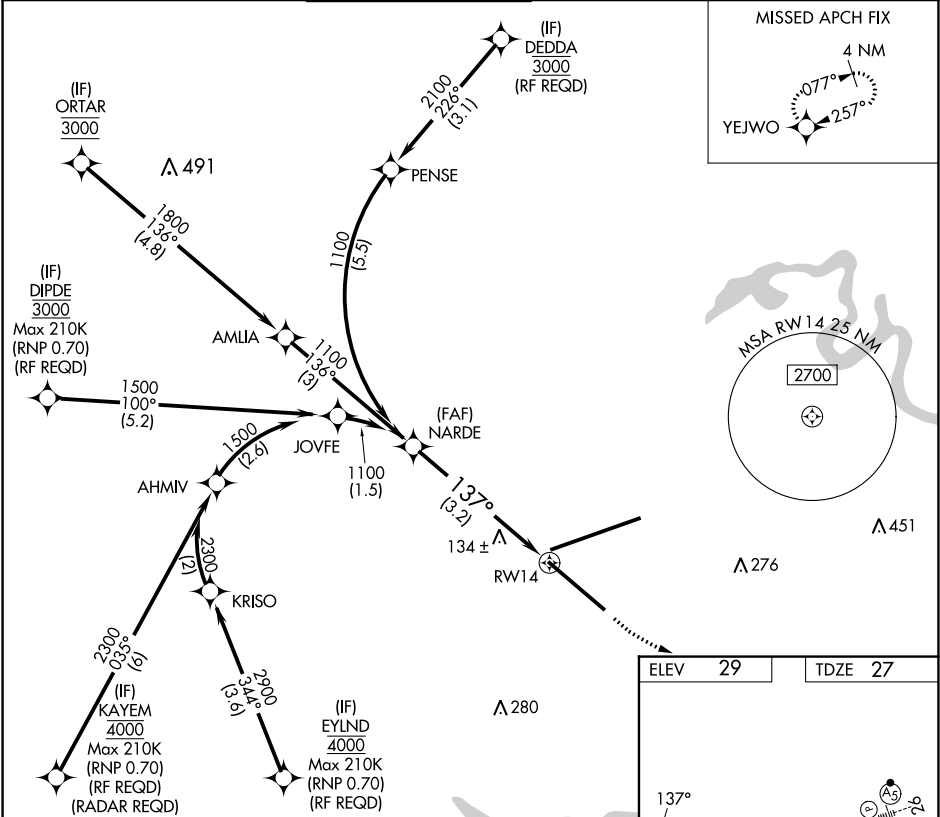

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 70).

NARDE

1100

GP 3.00° TCH 54

137°

See planview for multiple IF locations.

3.2 NM

500 2000 YEJWO

CATEGORY

RNP 0.30 DA

A B C D

389-1 362 (400-1)

AUTHORIZATION REQUIRED

ELEV 29 TDZE 27

137°

10000 X 150

7701 X 150

TWR 191

201

REIL Rwy 32

TDZ/CL Rwys 8, 14, and 26

HIRL Rwys 8-26 and 14-32

SE-3, 30 NOV 2023 to 28 DEC 2023

SE-3, 30 NOV 2023 to 28 DEC 2023