

APP CRS
329°

Rwy Idg
10400

TDZE
121

Apt Elev
151

RNAV (RNP) RWY 33

TED STEVENS ANCHORAGE INTL (ANC) (PANC)

RNP AR APCH. RF required.


▼

✱ -22°C

For uncompensated Baro-VNAV systems,
procedure NA below -17°C or above 54°C.

MISSED APPROACH: Climb to 4000 on the RNAV missed approach route to BGQ VORTAC and hold.

D-ATIS	ANCHORAGE APP CON	ANCHORAGE TOWER	GND CON	CLNC DEL
135.5	118.6 290.5	118.3 257.8	121.9 338.25	119.4 323.1

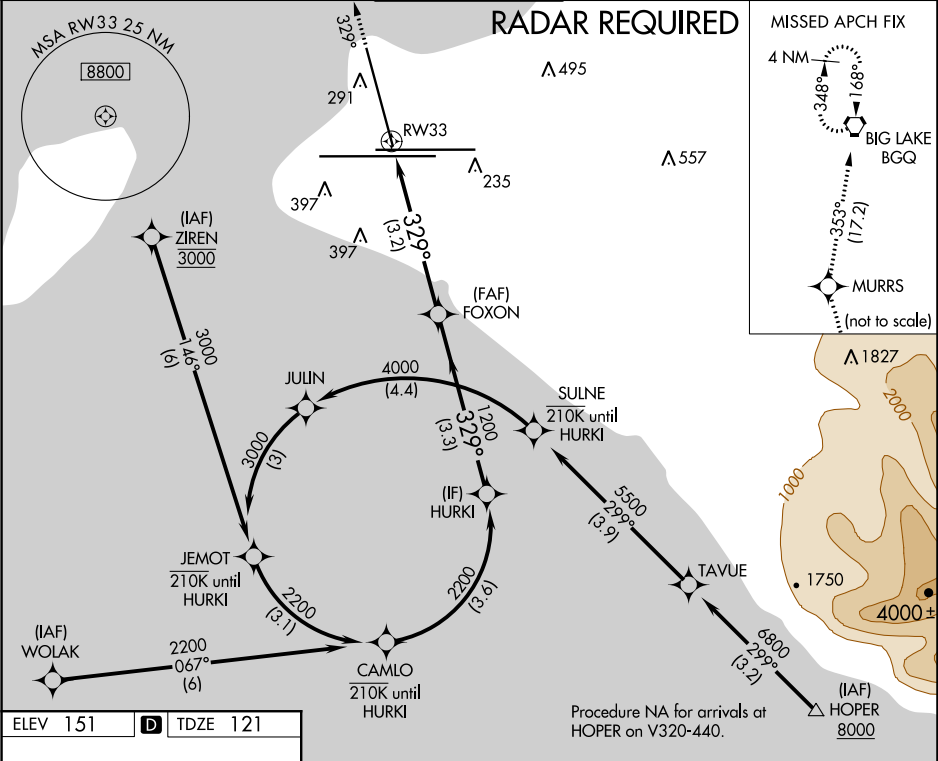

4000

MURRS

tr 329°

tr 353°

BGQ

FOXON

1200

329°

2200

GP 3.00°

TCH 60

RW33

3.2 NM

3.3 NM

CATEGORY	A	B	C	D
RNP 0.11 DA	463-1	342 (400-1)		
RNP 0.20 DA	525-1 1/8	404 (400-1 1/8)		
RNP 0.30 DA	687-1 5/8	566 (600-1 5/8)		

REIL Rwy 33

TDZ/CL Rwy 7L and 7R

HIRL all Rwy 33

329°

243

0.4% UP

0.5% DOWN

0.5% DOWN

12400 X 200

10600 X 150

10665 X 200

TWR 277

243