




APP CRS 058°	Rwy Idg TDZE Apt Elev	9000 773 799
------------------------	-----------------------------	---

RNAV (RNP) Z RWY 6L
CLEVELAND-HOPKINS INTL (CLE)

RNP AR APCH.  For uncompensated Baro-VNAV systems, procedure NA below -18°C (0°F) or above 54°C (130°F). For inop ALS, increase RNP 0.17 all Cnts visibility to RVR 5500 and RNP 0.30 all Cnts visibility to RVR 6000.				ALSF-2 		MISSED APPROACH: Climb to 3000 direct ACAPO and on track 001° to PASLE and hold.	
D-ATIS ARR 127.85 DEP 132.375		CLEVELAND APP CON 126.55 346.325		CLEVELAND TOWER 124.5 273.45		GND CON 121.7 273.45	
						CLNC DEL 125.05 273.45	
						CPDLC	

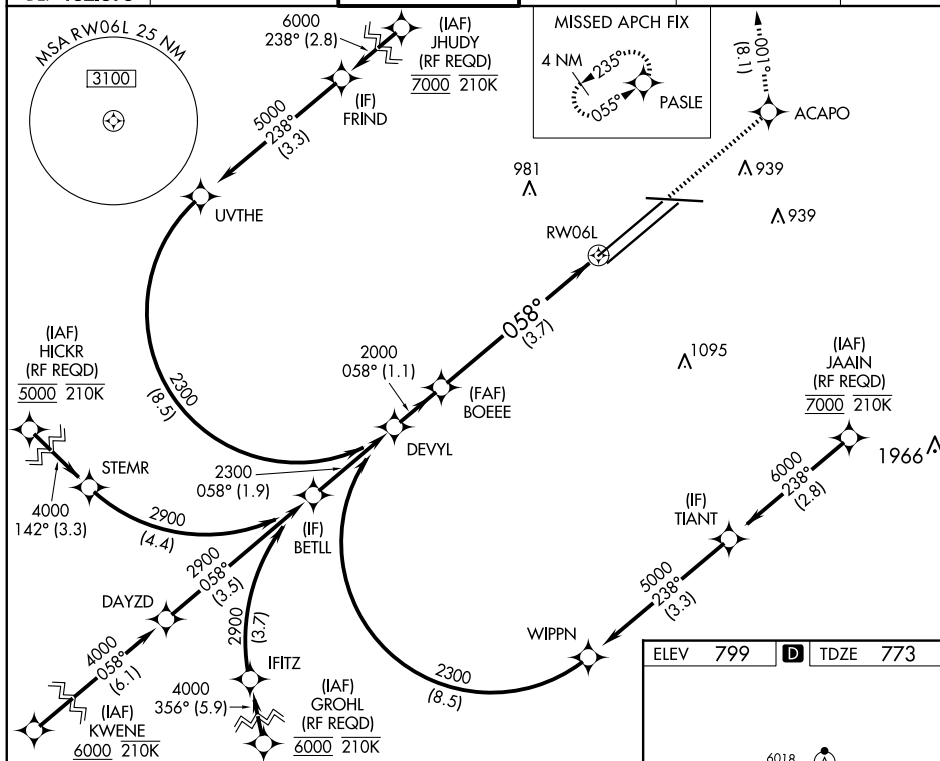

ELEV	799	D	TDZE	773
------	-----	----------	------	-----

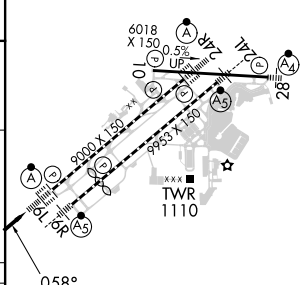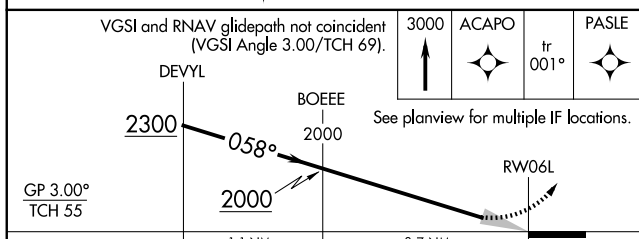

CATEGORY	A	B	C	D
RNP 0.17 DA	1123/30		350 (400- ⁵ / ₆)	
RNP 0.30 DA	1176/40		403 (400- ³ / ₄)	

AUTHORIZATION REQUIRED

REIL Rwy 10
TDZ/CL Rwy 6L, 6R, 24L, and 24R
HIRL Rwy 6L-24R, 6R-24L and 10-28