

LOC I-PDT <u>110.3</u>	APP CRS 254°	Rwy Idg TDZE Apt Elev	6301 1487 1497
----------------------------------	------------------------	-----------------------------	---

ILS or LOC RWY 26

EASTERN OREGON RGNL AT PENDLETON (PDT)

DME required.



T DME from PDT VORTAC. Simultaneous reception of I-PDT
A and PDT DME required.
*RVR 1800 authorized with use of FD or AP or HUD to DA.

MALSR



MISSED APPROACH: Climb to 4200 direct PDT VORTAC and hold, continue climb-in-hold to 4200.

ASOS 118.325	SPOKANE APP CON ★ 133.15 379.15	PENDLETON TOWER ★ 119.7 (CTAF) 0 257.8	GND CON 121.9 257.8	UNICOM 122.95
-----------------	------------------------------------	---	------------------------	------------------

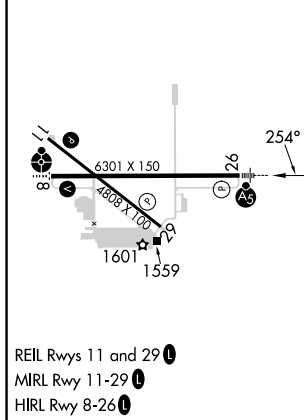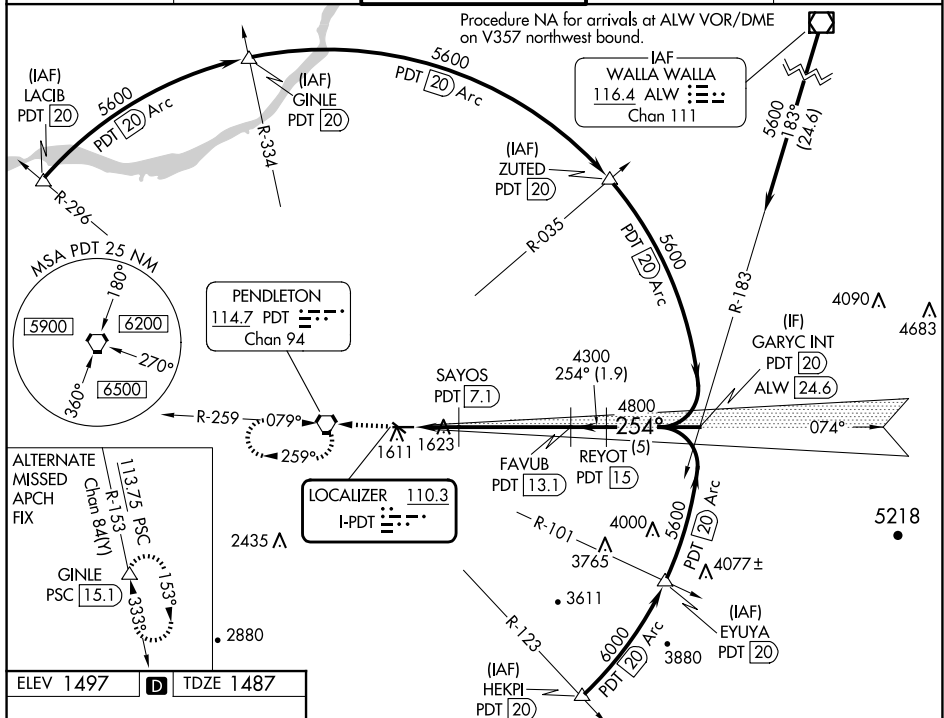

VGSI and ILS glidepath not coincident
(VGSI Angle 3.00/TCH 48).

GARYC INT
PDY 20

REYOT
PDY 15

FAVUB
PDY 13.1

SAYOS
PDY 7.1

PDY 5.7

PDY 4.6

2320

4300

4800

5600

25°

GS 3.00%
TCH 55

1.1 NM

1.4 NM

6 NM

1.9 NM

5 NM

CATEGORY	A	B	C	D
S-ILS 26*	1687/24 200 (200-½)			
S-LOC 26	1880/24 393 (400-½)	1880/40 393 (400-¾)		
C CIRCLING	1920-1 423 (500-1)	1960-1 463 (500-1)	1980-1½ 483 (500-1½)	2200-2¼ 703 (800-2¼)

ILS or LOC RWY 26