

WAAS
CH **65744**
W23A

APP CRS
233°

Rwy Idg **7543**
TDZE **710**
Apt Elev **716**

RNAV (GPS) RWY 23

WILLOW RUN (YIP)

RNP APCH - GPS.

▼


▲

For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to ¾ SM, LNAV Cats C/D visibility to 1 SM.

MALSR

MISSED APPROACH:
Climb to 3000 direct
ZAVEX and hold,
continue climb-in-hold
to 3000.

ATIS 127.425	DETROIT APP CON 118.95 284.0	WILLOW RUN TOWER 125.275 256.9	GND CON 119.975
------------------------	--	--	---------------------------

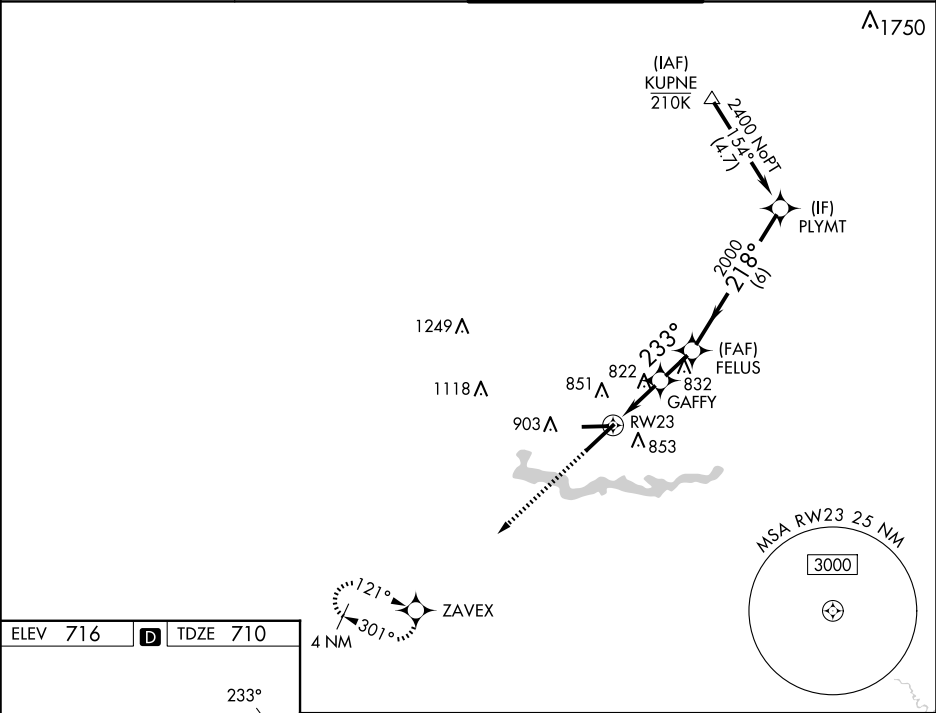

ELEV 716	D	TDZE 710
3000 ZAVEX		
RW23 GAFFY FELUS PLYMT		
1 NM 1.3 NM 1.6 NM 6 NM		
CATEGORY	A	B C D
LPV DA	910-½	200 (200-½)
LNAV/VNAV DA	982-½	272 (300-½)
LNAV MDA	1080-½ 370 (400-½)	1080-⅝ 370 (400-⅝)
C CIRCLING	1220-1 504 (600-1)	1220-1½ 504 (600-1½) 1400-2¼ 684 (700-2¼)

EC-1, 17 APR 2025 to 15 MAY 2025

EC-1, 17 APR 2025 to 15 MAY 2025