

APP CRS

036°

Rwy Idg

10001

TDZE

633


Apt Elev

645

RNAV (RNP) X RWY 3R

DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH.			ALSIF-2		MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAUGE and hold.		
T Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C.							
D-ATIS	DETROIT APP CON	METRO TOWER		GND CON		CLNC DEL	CPDLC
133.675	125.15 284.0	118.4 317.725		121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)			

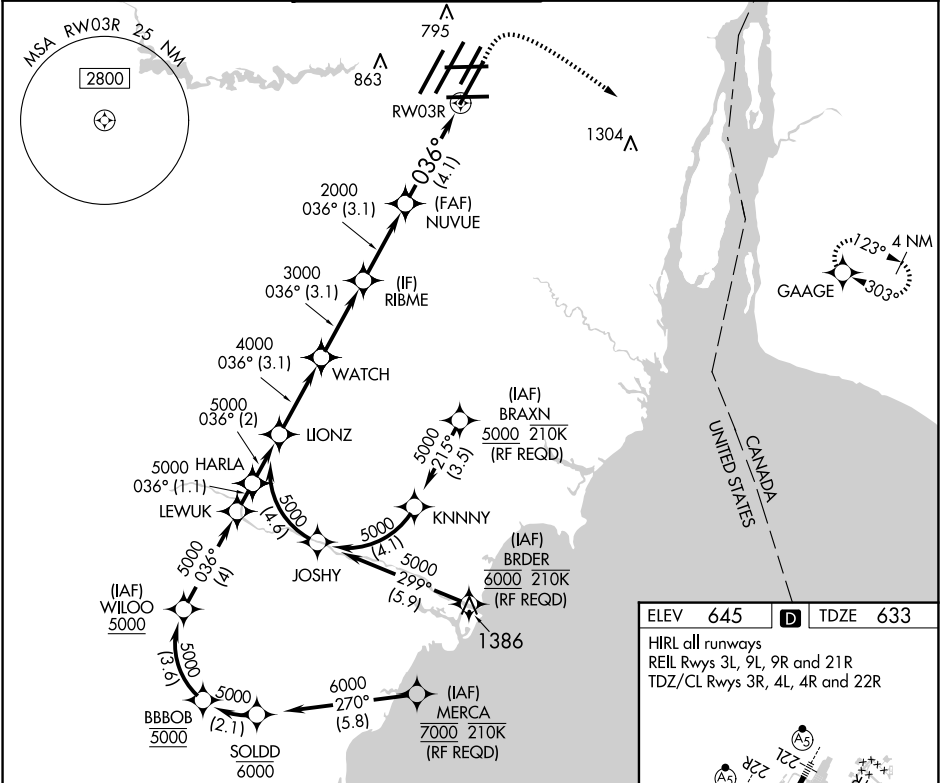

VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 70).										
LIONZ		WATCH		RIBME		NUVUE				
5000		036° 4000		3000		2000		RW03R		
GP 3.00° TCH 54										
3.1 NM		3.1 NM		3.1 NM		4.1 NM				
CATEGORY		A		B		C		D		
RNP 0.30 DA				1021/35		388 (400-%)				
AUTHORIZATION REQUIRED										

