

APP CRS
230°

Rwy Idg
TDZE
790

Apt Elev
796

RNAV (RNP) Z RWY 23L
INDIANAPOLIS INTL (IND)

RNP AR APCH - GPS.


▼

For uncompensated Baro-VNAV systems, procedure NA below -20°C or above 54°C. Simultaneous approach authorized for arrivals from LLRY only.

MALSR

MISSED APPROACH: Climb to 1500, then climbing left turn to 3000 direct OZMOE and hold.

D-ATIS 134.25	INDIANAPOLIS APP CON 128.175 317.8	INDY TOWER 120.9 251.1	GND CON 121.9	CLNC DEL 128.75 251.1	CPDLC
-------------------------	--	----------------------------------	-------------------------	---------------------------------	-------

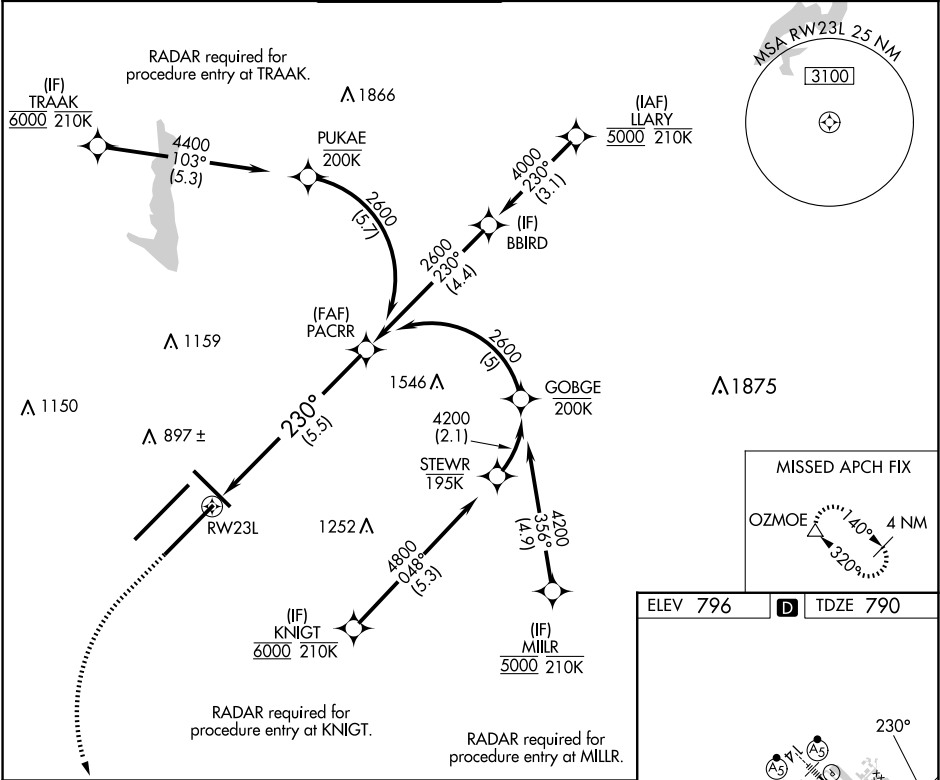

1500

3000

OZMOE

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 71).

See planview for multiple IF locations.

CATEGORY	A	B	C	D
RNP 0.30 DA	1175/35		385 (400-%)	

AUTHORIZATION REQUIRED

HIRL all Rwys
TDZ/CL Rwys 5L and 5R