
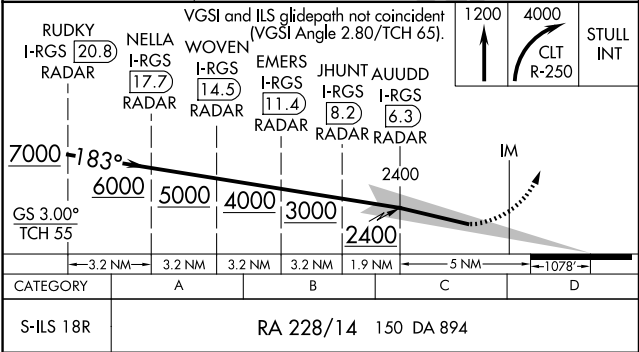


LOC/DME I-RGS 110.15 Chan 38(Y)	APP CRS 183°	Rwy Ldg TDZE 744 Apt Elev 748	ILS RWY 18R (SA CAT I) CHARLOTTE/DOUGLAS INTL (CLT)
---	------------------------	---	---

RADAR required for procedure entry. DME or RADAR required.			ALSIF-2		MISSED APPROACH: Climb to 1200 then climbing right turn to 4000 on CLT VOR/DME R-250 to STULL INT/CLT 13 DME and hold, continue climb-in-hold to 4000.	
⚠ Simultaneous approach authorized. Requires specific OPSPEC, MSPEC or LOA approval and use of HUD to DH.			Ⓜ			
CHARLOTTE APP CON			CHARLOTTE TOWER			GND CON
D-ATIS	128.325 (001°-119°)	257.2 (180°-359°)	118.1	257.8 (Rwys 18L-36R)		
121.15	120.05 (120°-295°)	307.8 (360°-179°)	126.4	257.8 (Rwy 18C-36C)	121.8 348.6 (W)	
	134.75 (296°-360°)		133.35	257.8 (Rwy 18R-36L)	121.9 348.6 (E)	

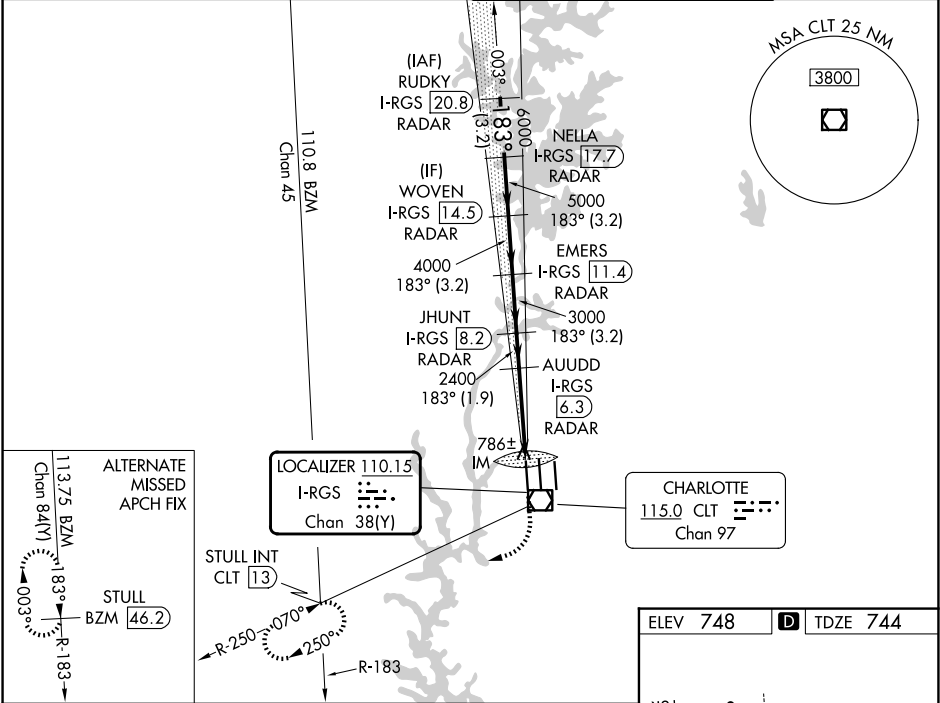

SA CATEGORY I ILS SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED		HIRL all Rwys REIL Rwys 18L and 23 TDZ/CL Rwys 18R, 36L, 36C and 36R
--	--	--