

WAAS CH 60911 W16B	APP CRS 163°	Rwy Ldg TDZE Apt Elev	9010 570 608
--	------------------------	-----------------------------	---

RNAV (GPS) Y RWY 16R

SEATTLE PAINE FLD INTL (P.A.E.)


▼

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -5°C (23°F) or above 54°C (130°F). Circling Rwy 34R NA at night. DME/DME RNP-0.3 NA. For inop ALS, increase LNAV/VNAV Cats A/B visibility to RVR 5000.

MALSR

MISSED APPROACH: Climb to 1100 then climbing right turn to 2000 direct ECEPO and hold.

ATIS 128.65	SEATTLE APP CON 128.5 306.9	PAINE TOWER★ 132.95 (CTAF) 0 256.7	GND CON 121.8 339.8	UNICOM 122.95
-----------------------	---------------------------------------	--	-------------------------------	-------------------------

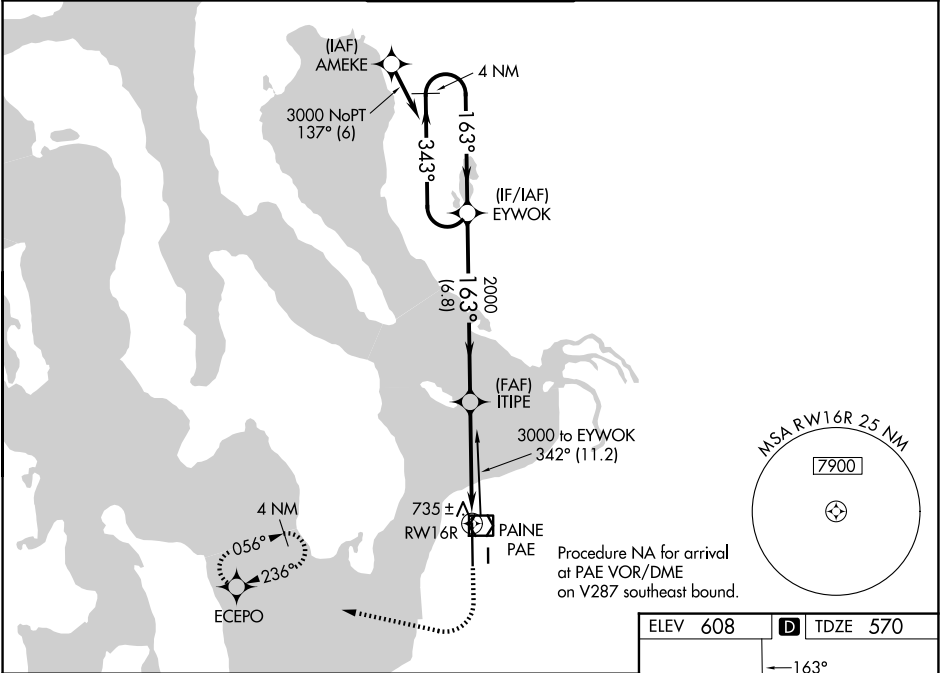

VGSI and descent angles not coincident (VGSI Angle 3.00/TCH 74).

4 NM Holding Pattern

EYWOK

ITIPE

PAINE

3000

343°

163°

163°

2000

1.1 NM to RWY 16R

RWY 16R

GP 3.00°

TCH 57

6.8 NM

3.2 NM

1.1

CATEGORY

A

B

C

D

LPV DA

770/18

200 (200-½)

NA

LNAV/VNAV DA

894/30

324 (300-⅝)

NA

LNAV MDA

1000/24

430 (400-½)

NA

CIRCLING

1100-1

492 (500-1)

NA

ELEV 608

TDZE 570

163°

16R

AS

9010 X 150

9010 X 150

34L

TWR

191

3004 X 75

34R

TDZL/RCLS Rwy 16R

HIRL Rwy 16R-34L

REIL Rws 16L and 34R

MIRL Rwy 16L-34R