

APP CRS
329°

Rwy Ldg
10400

TDZE
121

Apt Elev
151

RNAV (RNP) RWY 33

TED STEVENS ANCHORAGE INTL (ANC) (PANC)


RNP AR APCH. RF required.

-21°C

For uncompensated Baro-VNAV systems,
procedure NA below -17°C or above 54°C.

MISSED APPROACH: Climb to 4000 on the RNAV missed approach route to BGQ VORTAC and hold.

D-ATIS	ANCHORAGE APP CON	ANCHORAGE TOWER	GND CON	CLNC DEL
135.5	118.6 290.5	118.3 257.8	121.9 338.25	119.4 323.1

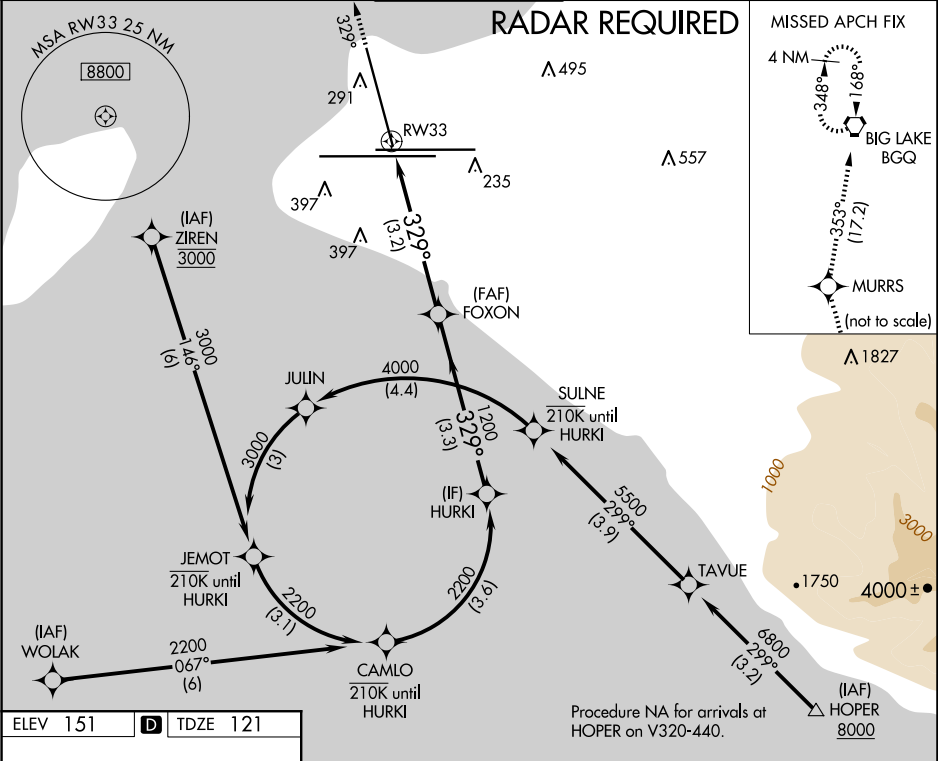

4000

MURRS

tr 329°

tr 353°

BGQ

FOXON

1200

HURKI

2200

GP 3.00°

TCH 60

AUTHORIZATION REQUIRED

4000

MURRS

tr 329°

tr 353°

BGQ

FOXON


1200

HURKI

2200

GP 3.00°

TCH 60

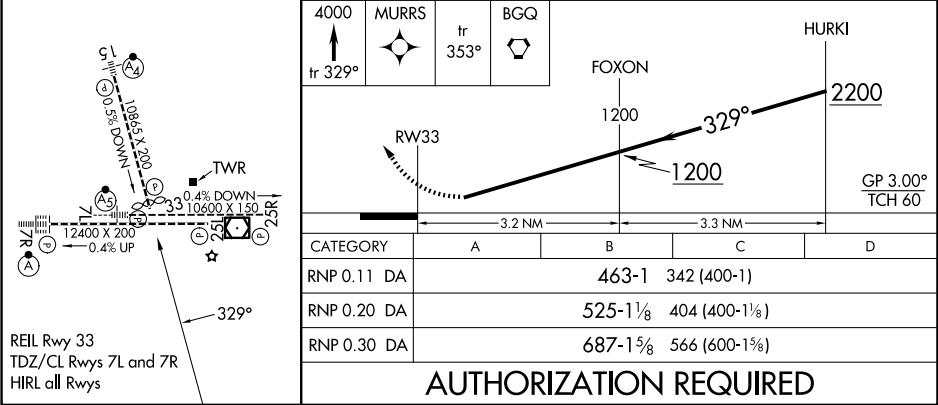AUTHORIZATION REQUIRED

4000

MURRS

tr 329°

tr 353°

BGQ

FOXON

1200

HURKI

2200

GP 3.00°

TCH 60

AUTHORIZATION REQUIRED

4000

MURRS

tr 329°

tr 353°

BGQ

FOXON

1200

HURKI

2200

GP 3.00°

TCH 60

AUTHORIZATION REQUIRED